
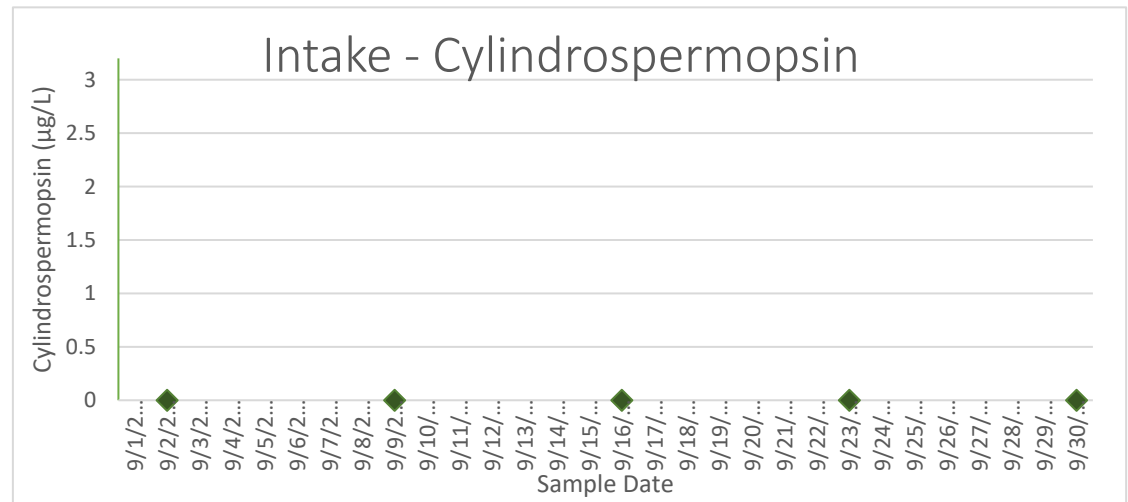


Intake Data - Raw River Water Entering the Geren Island Water Treatment Facility

Sample Date	Microcystin		Cylindrospermopsin		Laboratory
	Lab Reported Concentration ¹ (µg/L)	Minimum Reporting Level ² (µg/L)	Lab Reported Concentration ¹ (µg/L)	Minimum Reporting Level ² (µg/L)	
9/1/2024	0.305	0.2	#N/A	0.2	Willow Lake
9/2/2024	0.288	0.2	Non-Detect at MRL	0.2	Willow Lake
9/3/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/4/2024	0.206	0.2	#N/A	0.2	Willow Lake
9/5/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/6/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/7/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/8/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/9/2024	Non-Detect at MRL	0.2	Non-Detect at MRL	0.2	Willow Lake
9/10/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/11/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/12/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/13/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/16/2024	Non-Detect at MRL	0.2	Non-Detect at MRL	0.2	Willow Lake
9/17/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/20/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/23/2024	Non-Detect at MRL	0.2	Non-Detect at MRL	0.2	Willow Lake
9/24/2024	Non-Detect at MRL	0.2	#N/A	0.2	Willow Lake
9/30/2024	Non-Detect at MRL	0.2	Non-Detect at MRL	0.2	Willow Lake

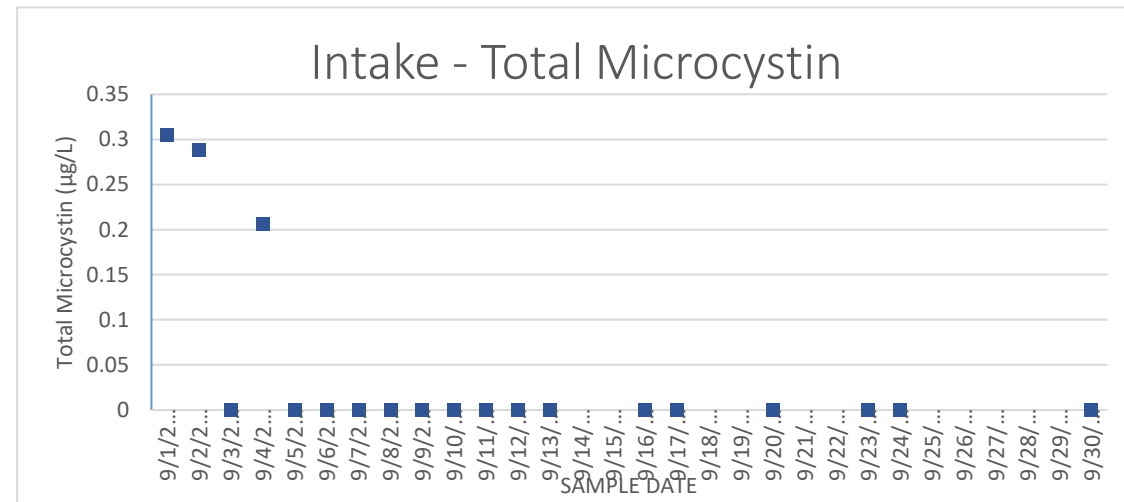

For more about cyanotoxins and drinking water advisories in Salem, visit: <https://www.cityofsalem.net/community/household/water-utilities/salem-s-drinking-water>